


## ENERGY EFFICIENCY CERTIFICATION (ERP)

Radiant Bruciatori SpA declares that the premixed generator condensing model **R2K 34 RAIN** has the following energy label [1] and has the following technical parameters referred to in Regulation 2013/813 / EU [2].

[1]

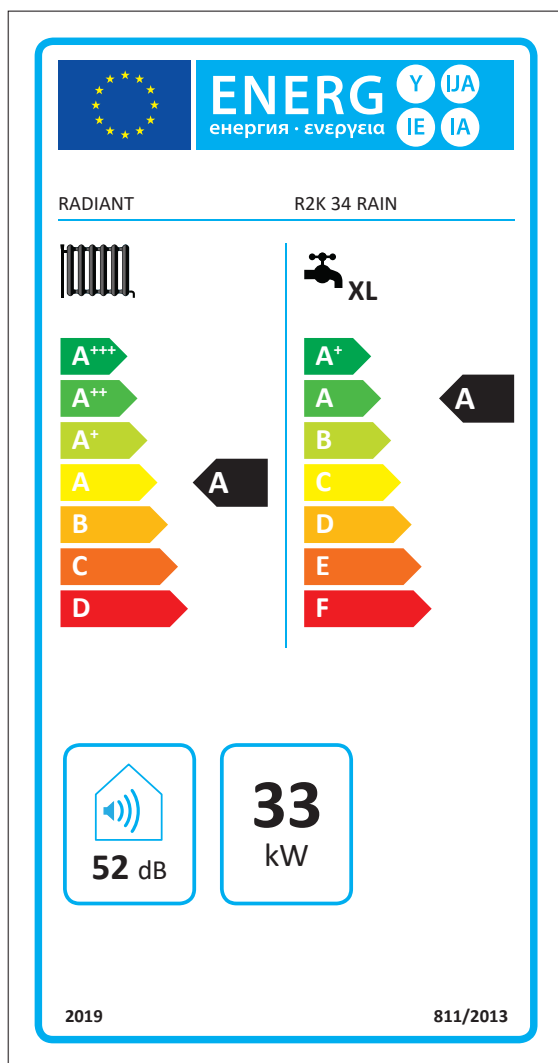

[2]

Model		R2K 34 RAIN
Condensing boiler	[yes/no]	yes
Low-temperature (**) boiler:	[yes/no]	no
B11 boiler	[yes/no]	no
Cogeneration space heater	[yes/no]	no
If yes, equipped with a supplementary heater	[yes/no]	no
Combination heater	[yes/no]	yes
Rated heat output Prated	kW	33
For boiler space heaters and boiler combination heaters: Useful heat output		
At rated heat output and high-temperature regime [*] P <sub>h</sub>	kW	33.35
At 30 % of rated heat output and low-temperature regime (**) P <sub>l</sub>	kW	10.20
Auxiliary electricity consumption		
At full load elmax	kW	0.04
At part load elmin	kW	0.02
In standby mode P <sub>sb</sub>	kW	0.004
Seasonal space heating energy efficiency η <sub>s</sub>	%	94
Seasonal space heating energy efficiency class		A
For boiler space heaters and boiler combination heaters: Useful efficiency		
At rated heat output and high-temperature regime [*] η <sub>h</sub>	%	88.30
At 30 % of rated heat output and low-temperature regime (**) η <sub>l</sub>	%	97.80
Other items		
Standby heat loss P <sub>stby</sub>	kW	0.1
Ignition burner power consumption P <sub>ign</sub>	kW	0.0
Emissions of nitrogen oxides NOx	mg/kWh	55
Annual energy consumption Q <sub>HE</sub>	kWh / GJ	29444 /106
Sound power level, indoors L <sub>WA</sub>	dB	52
For combination heaters:		
D.H.W. energy efficiency class		A
Declared load profile		XL
Daily electricity consumption Q <sub>elec</sub>	kWh	0,160
Annual electricity consumption AEC	kWh	59
Water heating energy efficiency η <sub>wh</sub>	%	83
Daily fuel consumption Q <sub>fuel</sub>	kWh	26,821
Annual fuel consumption AFC	GJ	18
Contact details	Tel. +39 0721 9079.1 - fax. +39 0721.9079299 - e-mail: info@radiant.it - http:// www. radiant.it	
Name and address of the supplier	RADIANT BRUCIATORI S.p.A. Via Pantanelli, 164/166 - 61025 - Montelabbate (PU)	
[*] High-temperature regime means 60 °C return temperature at heater inlet and 80 °C feed temperature at heater outlet.		
[**] Low temperature means for condensing boilers 30 °C, for low-temperature boilers 37 °C and for other heaters 50 °C return temperature [at heater inlet].		

This certificate is issued by Radiant Bruciatori spa as a result of the laboratory certification by Kiwa homologating authority.  
Certificate No.: KIP-16300/G.

Montelabbate, 30.09.2019

The Technical Director  
Paolo Battisti

